

1/3

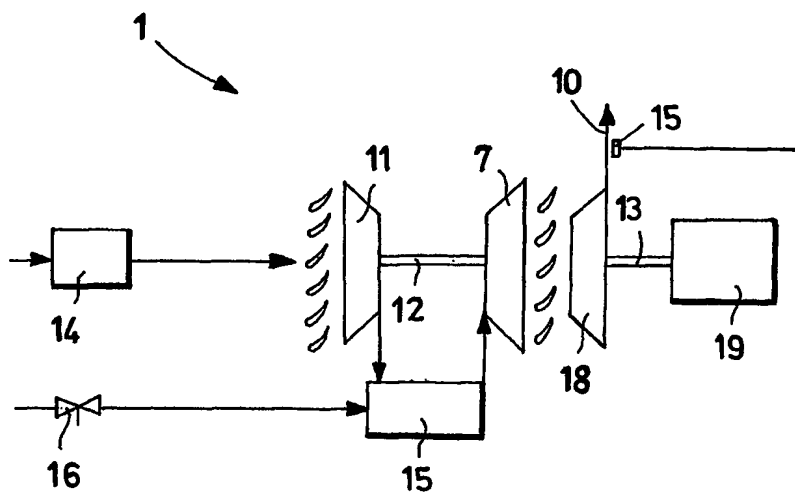


Fig.1

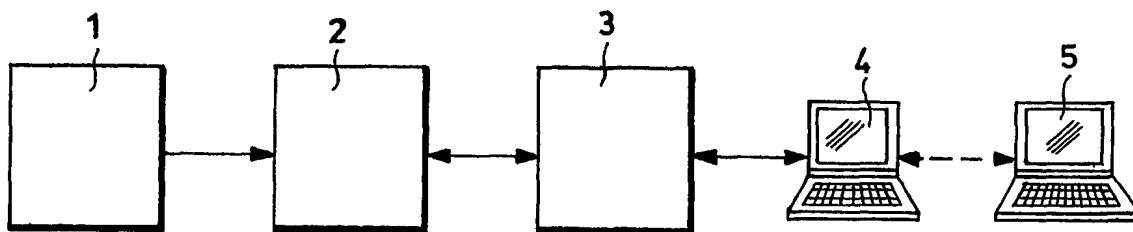
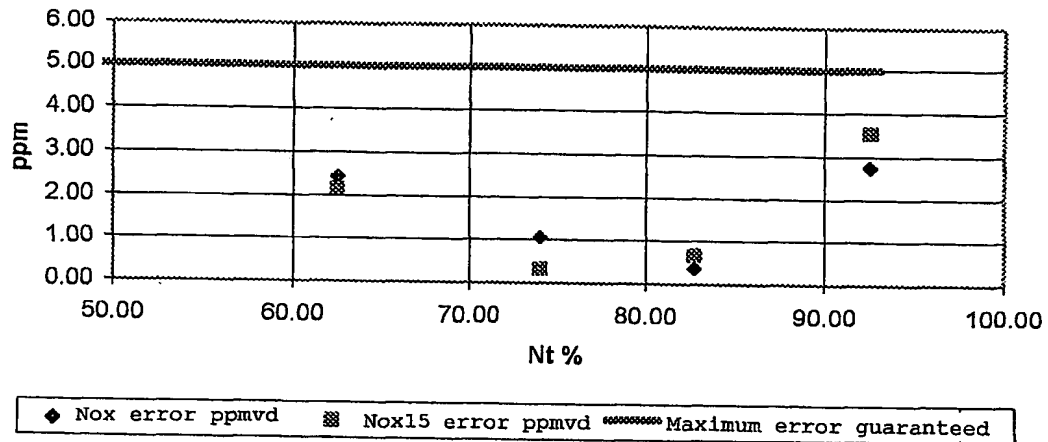


Fig.2

2/3


Nox error estimation

Unit: GE10 B2 DLN

Fig.3a

CO error estimation


Unit: GE10 B2 DLN

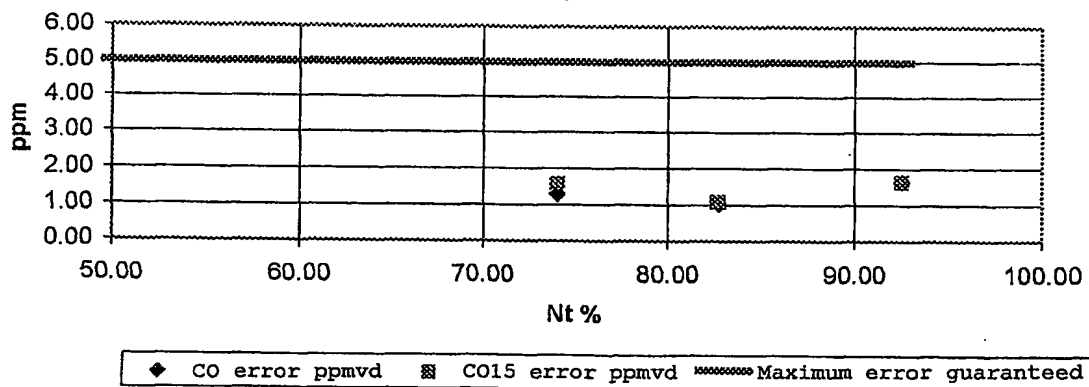Fig.3b

3/3

02% error estimation

Unit: GE10 B2 DLN1

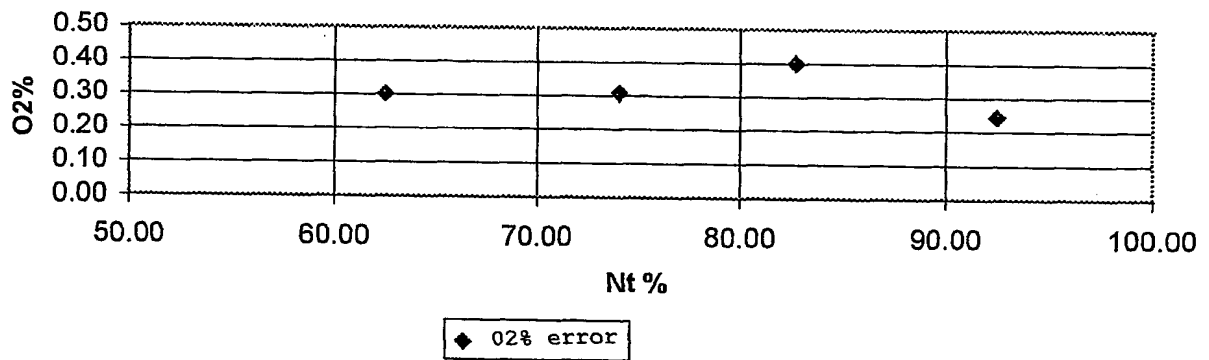Fig.3c